


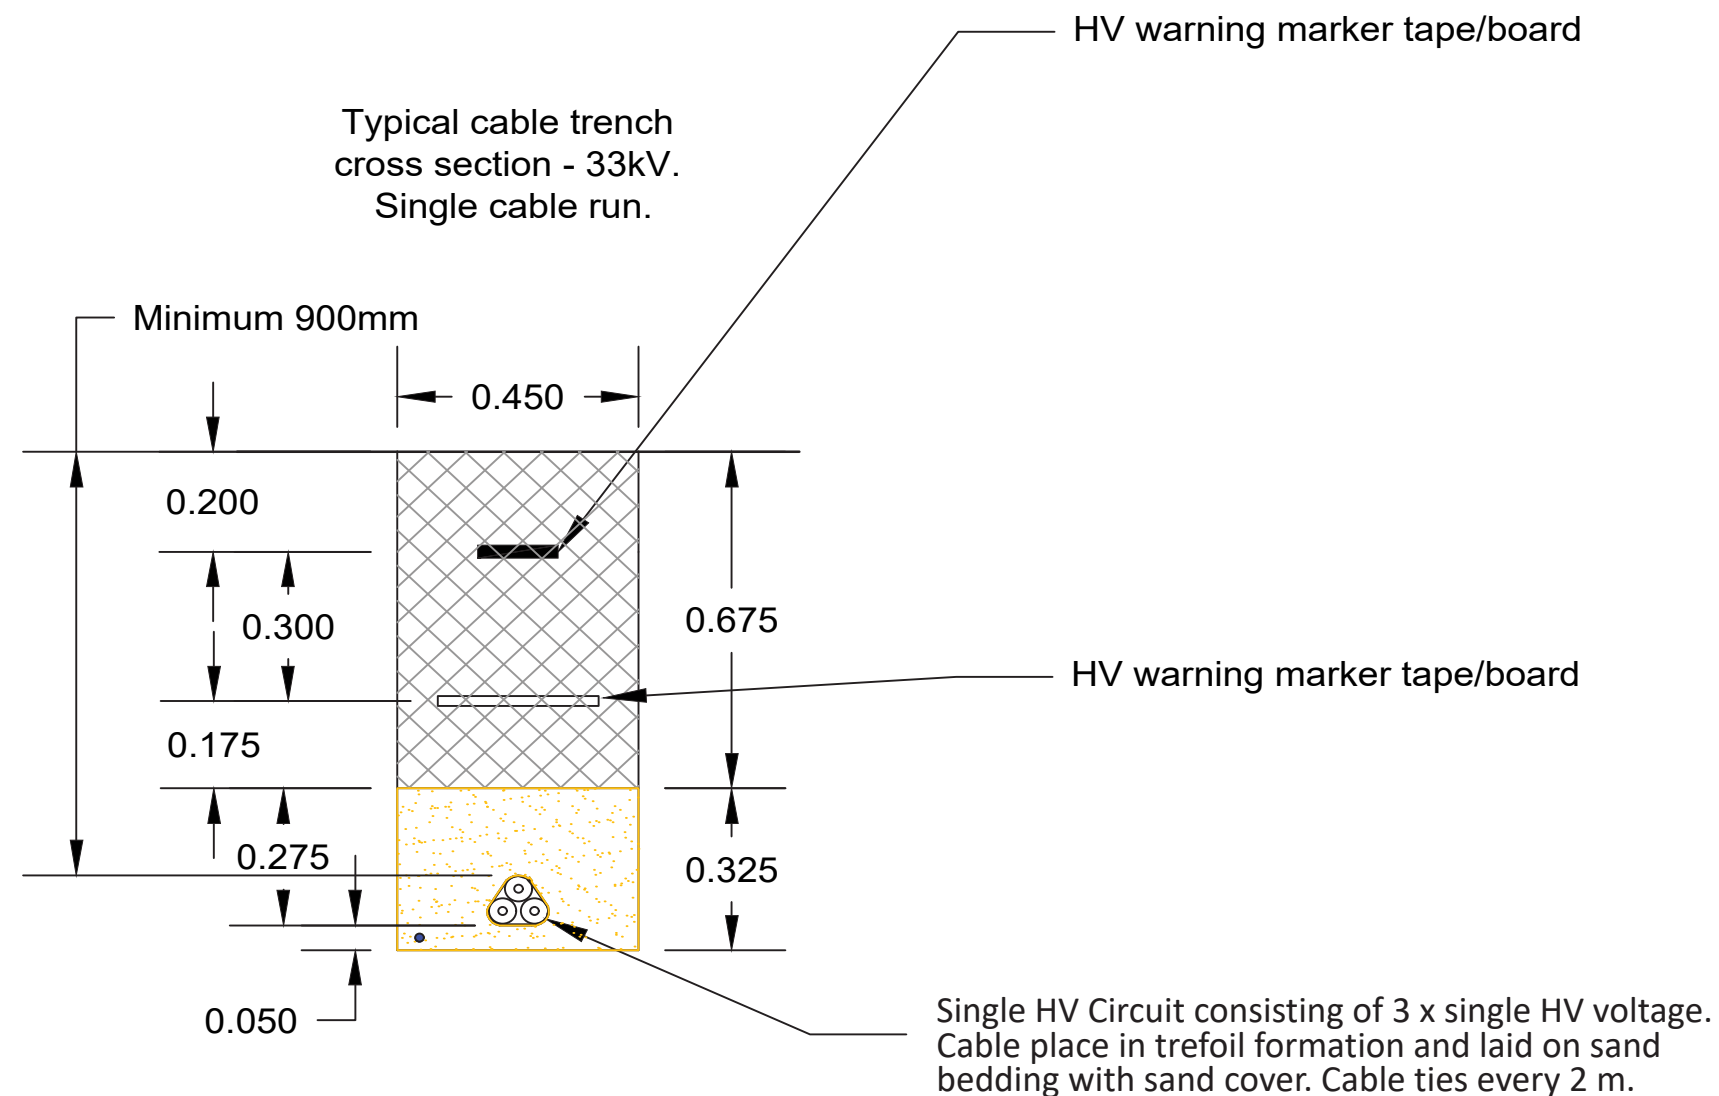

-  Backfill of Excavated Soils
-  Sand
-  Concrete
-  Earthing Cable
-  PVC 110mm Duct
-  PVC 200mm Ducts for 33kV Cabling

Figure Title Typical Cable Trench Section		
Project Name Neshion Energy Park		
Project No./File ID 1620015684 / REH2023N01765		
Date February 2026	Figure No. 2.8	Revision 1.0
Scale NOT TO SCALE	Prepared by SR	
Client Neshion Ltd		
		